
# City of Hendersonville, TN Typical Retaining Wall Details

Based on the 2012 International Residential Building Code

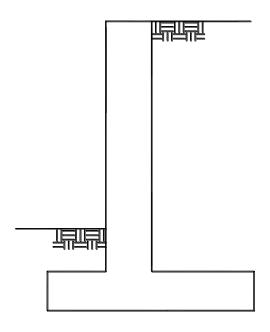

### **CONTENTS**

| Timber Retaining Wall              | . 2 |
|------------------------------------|-----|
| Reinforced Masonry Retaining Wall  | .4  |
| Reinforced Concrete Retaining Wall | . 7 |
| Typical Details                    | .8  |

The use of this package in lieu of submitted drawings applies to timber, reinforced masonry and reinforced concrete retaining walls with heights no greater than 5'-0", level backfill, no surcharge loading, and residential use only. The use of the City of Hendersonville *Typical Retaining Wall Details* for a tiered or stacked retaining wall system is strictly prohibited. Retaining walls must be constructed in strict conformance with the details contained herein. A copy of these retaining wall details should be kept on the job site and available for the inspector during the construction and inspection process.



Typical Retaining Wall Details

Based on the 2012 International
Residential Code June 1, 2013

Revised: 07/01/13 Sheet 1 of 9

# TIMBER RETAINING WALLS

## **GENERAL NOTES**

- 1. All lumber shall be 6x6, pressure treated in accordance with American Wood-Preservers' Association standards for ground contact, southern pine, grade #2 or better.
- 2. All spikes shall be 60d or equivalent, hot-dipped galvanized or stainless steel, and driven into predrilled holes. Spikes shall be of sufficient length to penetrate the base member a minimum of 2".
- 3. Member joints shall be staggered a minimum of 3'-6" from joints of the course above and below.
- 4. Each 6x6 member shall be secured at each end with 2-60d spikes driven vertically into the member below. Corners shall be secured with 2-60d spikes, driven horizontally as shown in FIGURE 4.

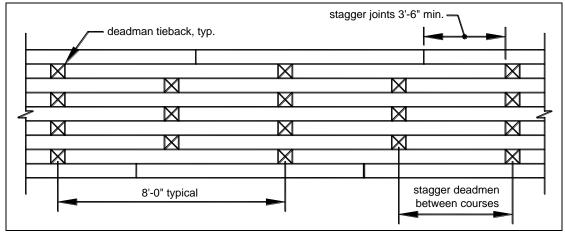


FIGURE 1: TYPICAL ELEVATION



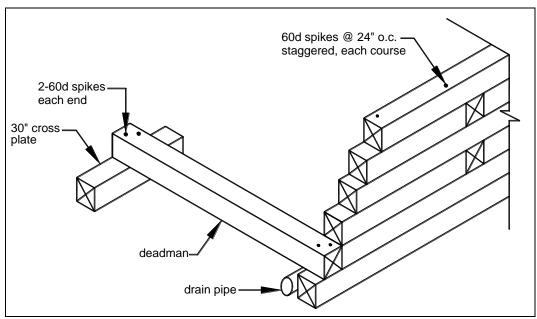


FIGURE 2: TYPICAL DEADMAN DETAIL

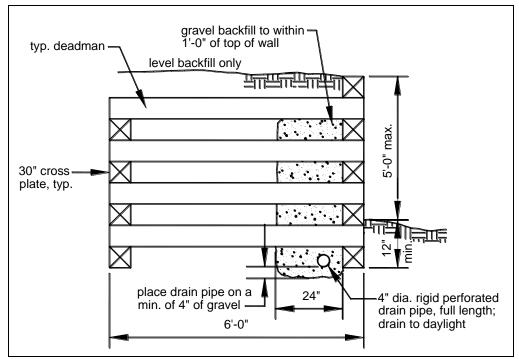

Typical Retaining Wall Details
Based on the 2012 International
Residential Code June 1, 2013

Revised: 07/01/13 Sheet 2 of 9



**FIGURE 3: TYPICAL SECTION** 


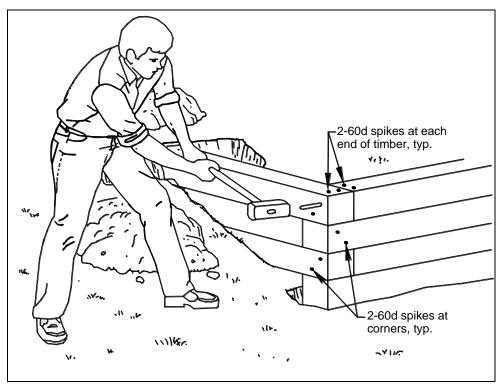


FIGURE 4: TYPICAL CORNER DETAIL



Typical Retaining Wall Details
Based on the 2012 International
Residential Code June 1, 2013

Revised: 07/01/13 Sheet 3 of 9

# REINFORCED MASONRY RETAINING WALLS

### **GENERAL NOTES**

- 1. The minimum concrete compressive strength at 28 days shall be 3,000 PSI and shall comply with ACI 318.
- 2. Reinforcing steel shall comply with ASTM A615 and shall have a yield strength of 60,000 PSI.
- 3. Concrete masonry blocks shall comply with ASTM C90.
- 4. All joint reinforcement, ties and other accessories shall be resistant to corrosion.
- 5. All head and bed joints shall be 3/8" thick. Bed joints of the starting course over the concrete foundation may be between 1/4" and 3/4". Mortar shall conform to ASTM C270.
- 6. Backfilling against reinforced masonry retaining walls shall not be permitted until at least 7 days after placing concrete or grout in cores. Heavy equipment shall maintain a distance away from the wall equal to the wall's height. Care shall also be taken to avoid exerting large impact forces on the wall.


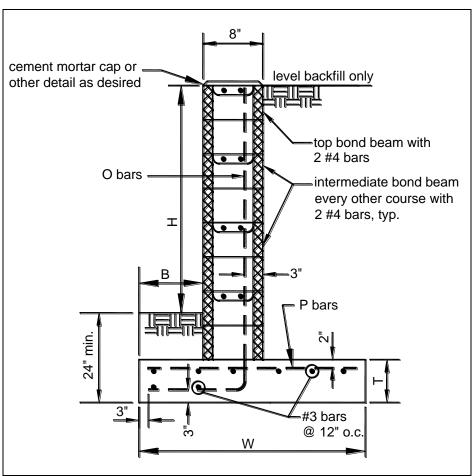


FIGURE 5: TYPICAL MASONRY WALL SECTION

**TABLE 1: TYPICAL MASONRY WALL SPECIFICATIONS\*** 

| <u> </u>   |     |       |     |                  |            |  |
|------------|-----|-------|-----|------------------|------------|--|
| Dimensions |     |       |     | Reinforcing Bars |            |  |
| Н          | В   | W     | Т   | 0                | Р          |  |
| 2'-0"      | 12" | 2'-8" | 9"  | #3@32"o.c.       | #3@27"o.c. |  |
| 2'-9"      | 12" | 3'-0" | 9"  | #4@32"o.c.       | #3@27"o.c. |  |
| 3'-6"      | 12" | 3'-3" | 10" | #5@32"o.c.       | #3@27"o.c. |  |
| 3'-10"     | 14" | 3'-8" | 10" | #4@16"o.c.       | #4@30"o.c. |  |
| 5'-0"      | 15" | 4'-2" | 12" | #6@24"o.c.       | #4@25"o.c. |  |

<sup>\*</sup>Reference: National Concrete Masonry Association.



Typical Retaining Wall Details
Based on the 2012 International
Residential Code June 1, 2013

Revised: 07/01/13 Sheet 4 of 9

During construction, install wire loop in bed joint; loosen wire before mortar sets. Using wire loop, position vertical reinf. prior to grouting core.

wire loop

FIGURE 6: VERTICAL REINFORCEMENT TIE HOLD DETAIL

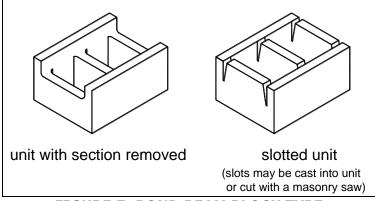


FIGURE 7: BOND BEAM BLOCK TYPE


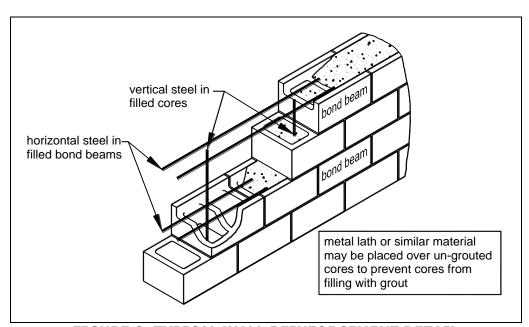


FIGURE 8: TYPICAL WALL REINFORCEMENT DETAIL



Typical Retaining Wall Details
Based on the 2012 International
Residential Code June 1, 2013

Revised: 07/01/13 Sheet 5 of 9

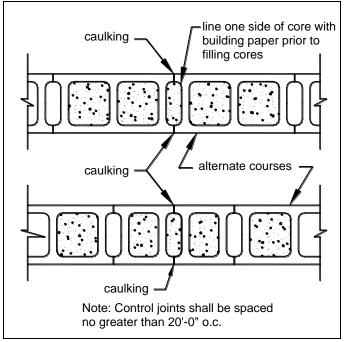


FIGURE 9: TYPICAL CONTROL JOINT DETAIL


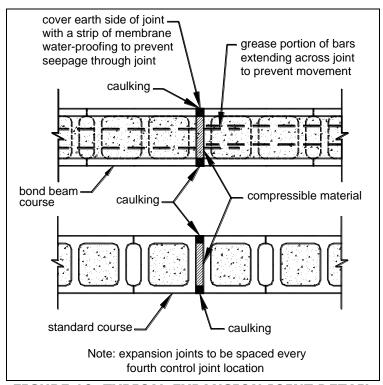


FIGURE 10: TYPICAL EXPANSION JOINT DETAIL

See Sheet 8 for more Typical Details.



Typical Retaining Wall Details
Based on the 2012 International
Residential Code June 1, 2013

Revised: 07/01/13 Sheet 6 of 9

# **CONCRETE RETAINING WALLS**

## **GENERAL NOTES**

- 1. The minimum concrete compressive strength at 28 days shall be 3,500 PSI and shall comply with ACI 318.
- 2. Reinforcing steel shall comply with ASTM A615 and shall have a yield strength of 60,000 PSI.
- 3. Backfilling against reinforced concrete retaining walls shall not be permitted until the concrete has reached its 28 day strength. Heavy equipment shall maintain a distance away from the wall equal to the wall's height. Care shall also be taken to avoid exerting large impact forces on the wall.


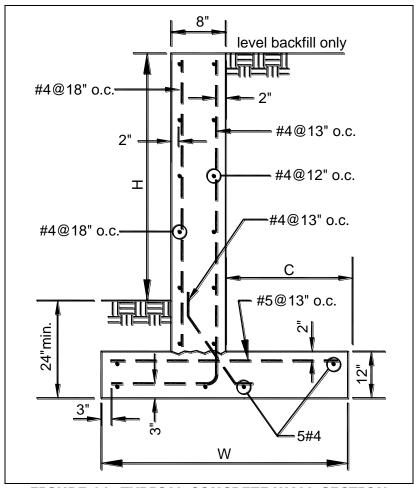


FIGURE 11: TYPICAL CONCRETE WALL SECTION

TABLE 2: TYPICAL CONCRETE WALL DIMENSIONS\*

| Н     | С     | W     |  |  |  |
|-------|-------|-------|--|--|--|
| 2'-0" | 11"   | 2'-1" |  |  |  |
| 3'-0" | 1-3"  | 2'-7" |  |  |  |
| 4'-0" | 1'-8" | 3'-1" |  |  |  |
| 5'-0" | 2'-0" | 3'-7" |  |  |  |

<sup>\*</sup>Reference: Concrete Reinforcing Steel Institute



Typical Retaining Wall Details
Based on the 2012 International
Residential Code June 1, 2013

Revised: 07/01/13 Sheet 7 of 9

# **TYPICAL DETAILS** (for masonry and concrete walls)

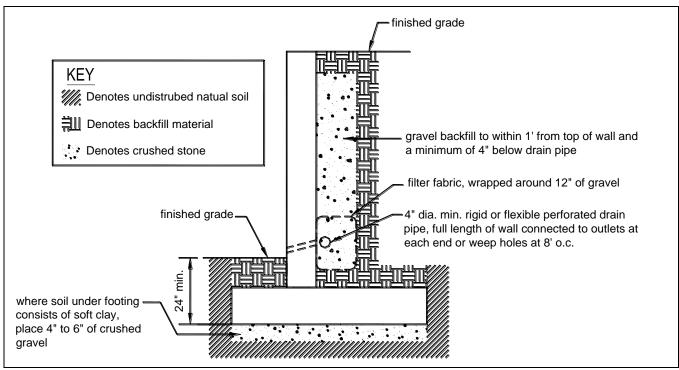


FIGURE 12: TYPICAL BACKFILL AND DRAINAGE DETAIL


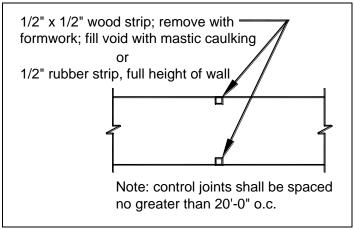


FIGURE 13: TYPICAL CONTROL JOINT DETAIL



Typical Retaining Wall Details
Based on the 2012 International
Residential Code June 1, 2013

Revised: 07/01/13 Sheet 8 of 9

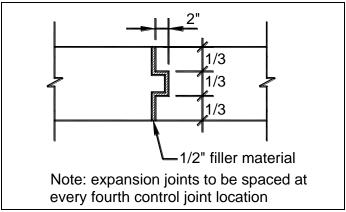


FIGURE 14: TYPICAL EXPANSION JOINT DETAIL


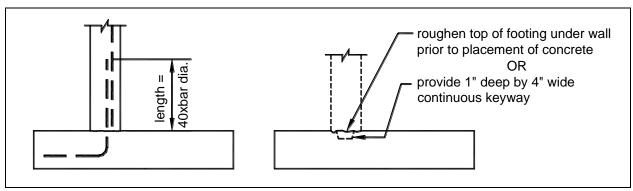


FIGURE 15: TYPICAL DOWEL AND KEYWAY DETAIL

The City of Hendersonville Tennessee Department of Building and Codes is committed to a policy of nondiscrimination in all of its programs, services and activities. For additional information or questions regarding this document please call 615-822-3802, or write Department of Building and Codes, 101 Maple Drive North, Hendersonville, TN 37075.





Typical Retaining Wall Details
Based on the 2012 International
Residential Code June 1, 2013

Revised: 07/01/13 Sheet 9 of 9